Safety Information


>All electrical work must be undertaken by a qualified contractor to ensure compliance with latest edition BS 7671 and IEE/IET wiring regulations.

> Before installing an LED IP20 Emergency Twin Spot or doing any maintenance, ensure power supply is turned off at the circuit breaker or fuse box.

> This product is designed for permanent connection to fixed wiring; the circuit should be protected with the appropriate MCB or fuse.

Environment

> Please DO NOT dispose of electrical items or packaging as unsorted waste. Use the recycling facilities provided by your local authorities.

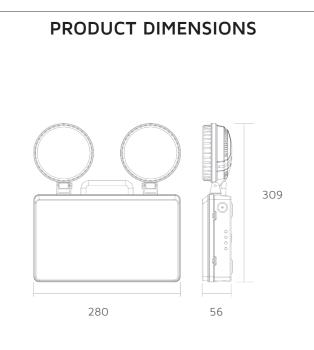

Important Warranty Information

The LED IP20 Emergency Twin Spot has a 3 year warranty. To claim you must provide the product part number and date of manufacture, which can be found on the label attached to the luminaire housing along with the original purchase invoice. Battery warranty is 1 year only.







NET LED Ltd. Buckingway Business Park 300 Anderson Road Cambridge CB24 4UQ sales@netled.co.uk www.netled.co.uk Technical Helpline: 01223 851505 Email: support@netled.co.uk


Drawing No: NET-44-10-70_V1 www.netled.co.uk/downloads




LED IP20 EMERGENCY TWIN SPOT

LED IP20 EM TWIN SPOT NET-44-10-68

KEY DATA						
Light Source:	LED					
Size (mm)	280 x 308.5 x 55.5mm					
Power	5.2W					
Luminous Flux	2 x 1931m					
Colour Temperature	6500K					
Housing Material	Polycarbonate					
IP Rating	IP20					
Manufacturer	DPPUL					

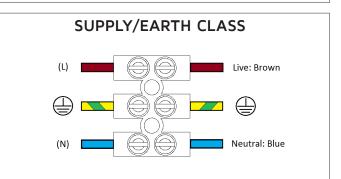



All units are in mm

Installation procedure: Carefully read the installation instructions and ensure the mains supply is isolated before installation. Please follow the safety information overleaf before carrying out any installation. Please retain this leaflet for future reference.									
Step 3: Connect the permanent live neutral and earth per the diagram below. Connect the battery using the plug to the main board. Ensure all connections are correct and tight.	Step 4: Switch on the power source and ensure the charge LED is lit. Close the cover and fail the power source after a few minutes to check for correct dis-charge operation. Leave the product on charge for an initial 24 hours to allow the battery to charge completely.								

1 Connect the battery 2 Switch on the Main Supply - Check the charge LED illuminates

3 Switch off the Main Supply

4 Check the charge LED extinguishes and luminaire functions in emergency mode

Monthly Test		Year 1		Year 2		Year 3		Year 4		Year 5	
		Sign	Date								
1	Functional										
2	Functional										
3	Functional										
4	Functional										
5	Functional										
6	One Hour										
7	Functional										
8	Functional										
9	Functional										
10	Functional										
11	Functional										
12	Three Hour										