

Installation Instructions





Instrucciones de instalación, Instructions d'installation, Installationsanleitung, إرشادات التركيب,
Installatie-instructies, Instruções de instalação, Installatie-instructies,
設置手順説明, Οδηγίες εγκατάστασης



Product Code:(AXPL/1/3NM)



Master
Translations
QR Link

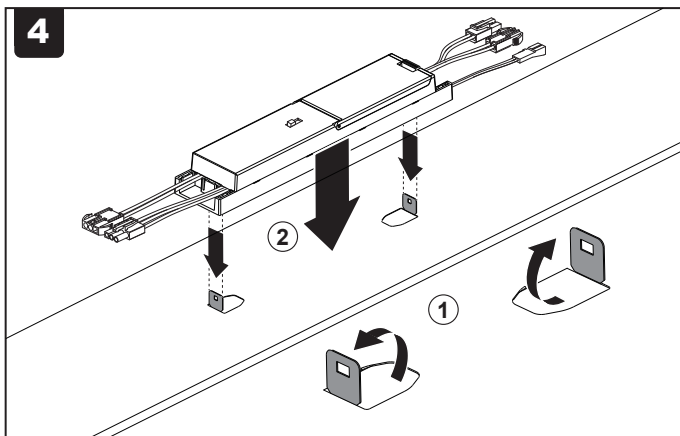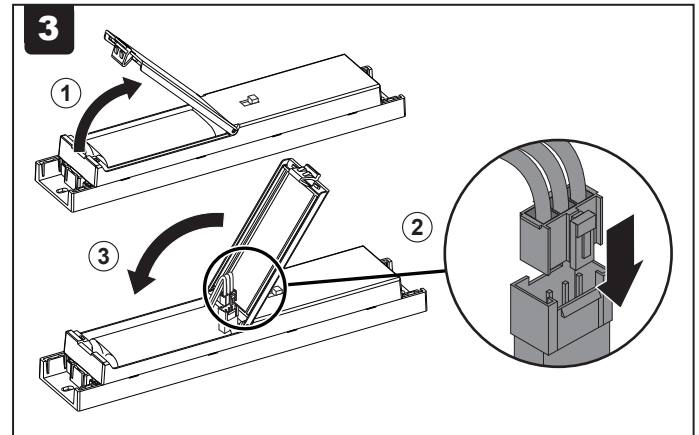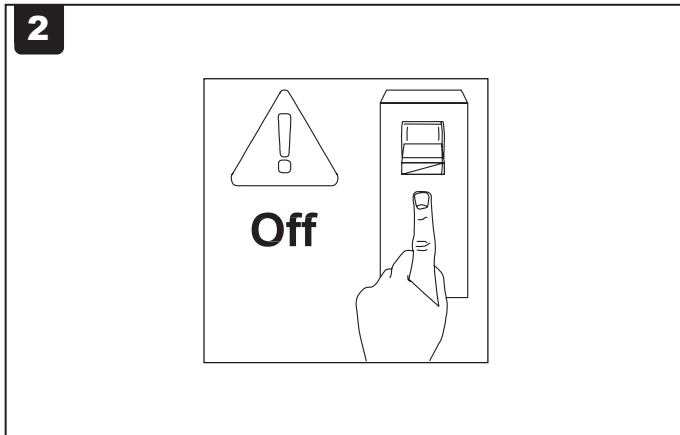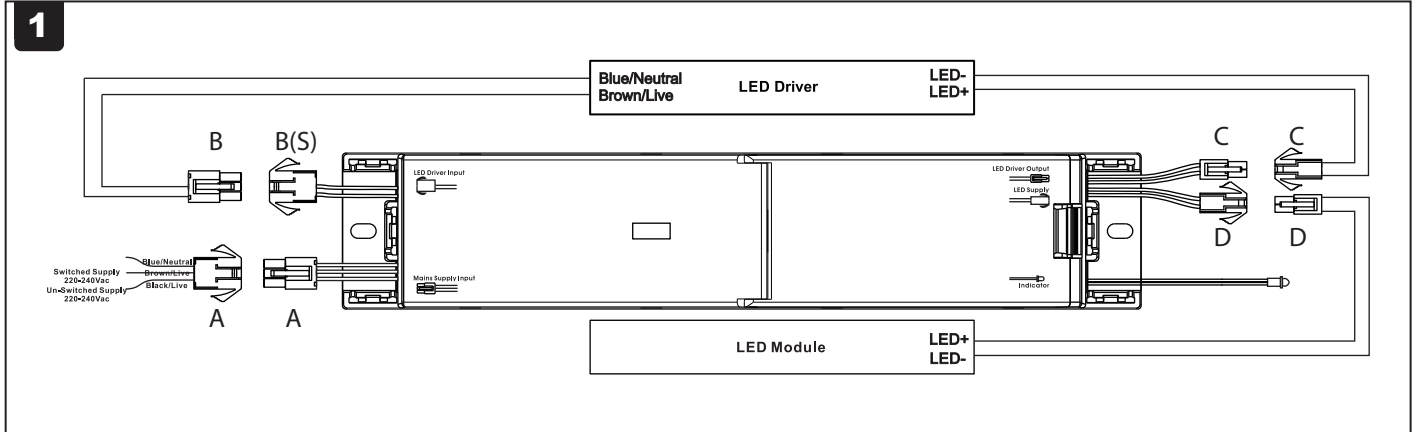

Ansell Electrical Products
Unit 6B, Stonecross Industrial
Park,
Yew Tree Way,
Warrington,
WA3 3JD

Ansell (Sales & Distribution)
Unit 2, M2 Business Park,
Duncrue Street,
Belfast,
BT3 9AQ

Ansell (Sales & Distribution) Republic of Ireland Limited
Unit G1, Block G,
Calmount Park, Ballymount
Dublin 12,
D12 TH56

www.ansell-lighting.com


Warrington Tel: +44 (0)1942 433333

Belfast Tel: +44 (0)2890 773750

International Tel: +44 (0)2890 773750

Spain Tel: 00 34 938 005642

Issue Number: [1]

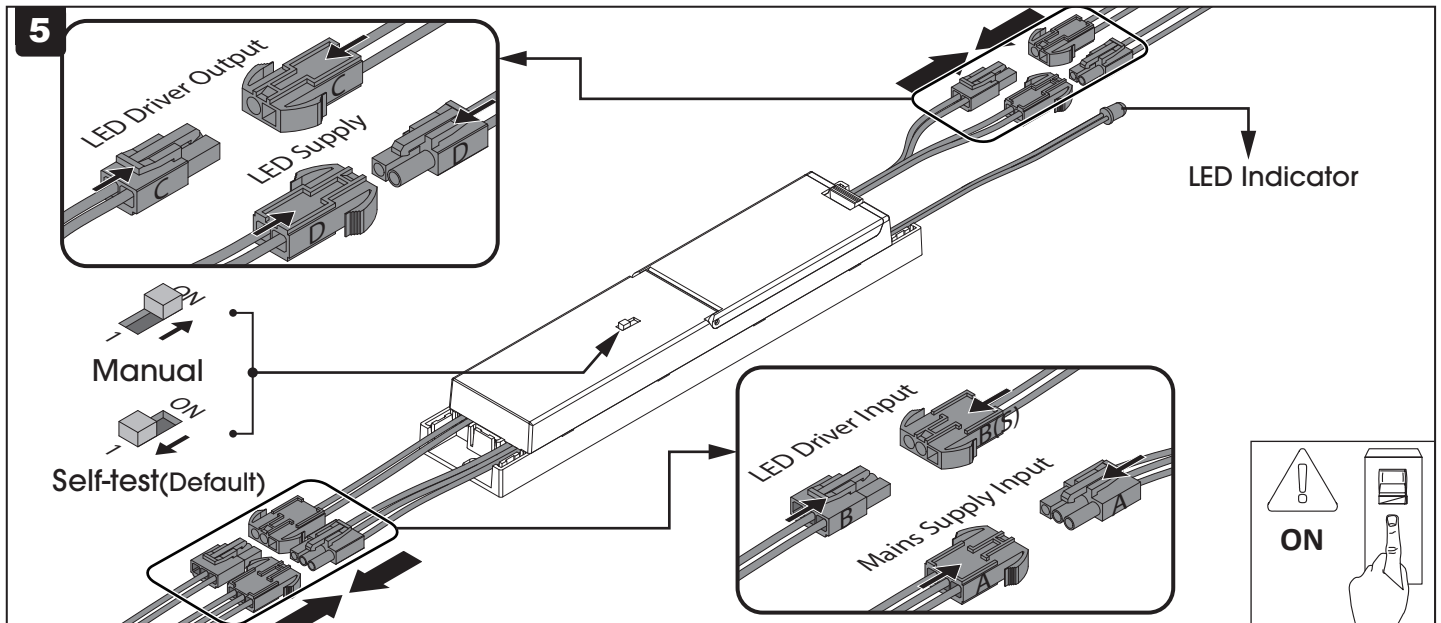

6

Emergency LED System Status

LED indication	Description	Status	Manual Mode	Self-test Mode	Comment
	Green Permanently On	System Healthy	✓	✓	AC Mode
	Permanently OFF	Emergency Mode: Mains failure or mains disconnected	✓	✓	
		Battery Disconnected	✓	N/A	
		Battery Charge Inhibited	✓	✓	Battery outside operating temp
	Green Slow Flash (1s on-1s off)	Duration Test Running	N/A	✓	
	Green Fast Flash (0.1s on-0.1s off)	Functional Test Running	N/A	✓	
	Red Permanently On	Load Fault	N/A	✓	Open circuit/ LED failure
	Red Slow Flash (1s on-1s off)	Battery Fault	N/A	✓	Battery failed the duration test or function test / Battery is defect or deep discharged/ Incorrect battery voltage
	Red Fast Flash (0.1s on-0.1s off)	Battery Charging Fault	N/A	✓	Incorrect charging current