

Installation Instructions

Instrucciones de instalación, Instructions d'installation, Installationsanleitung, إرشادات التركيب,

Installatie-instructies, Instruções de instalação, Installatie-instructies,





設置手順説明, Οδηγίες εγκατάστασης



Product Code:{AXPL/1/3NM/DA}



Master
Translations
QR Link

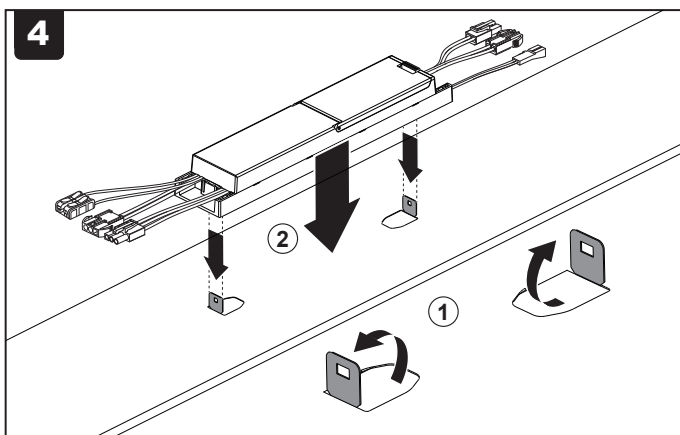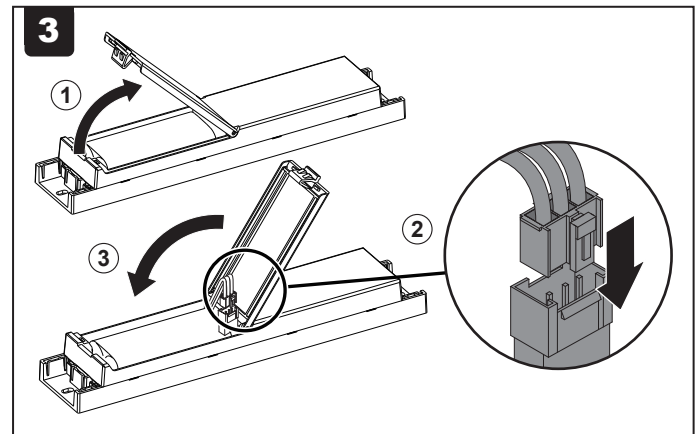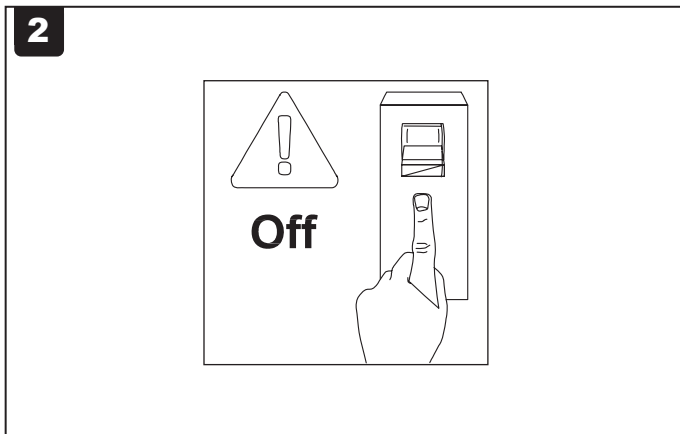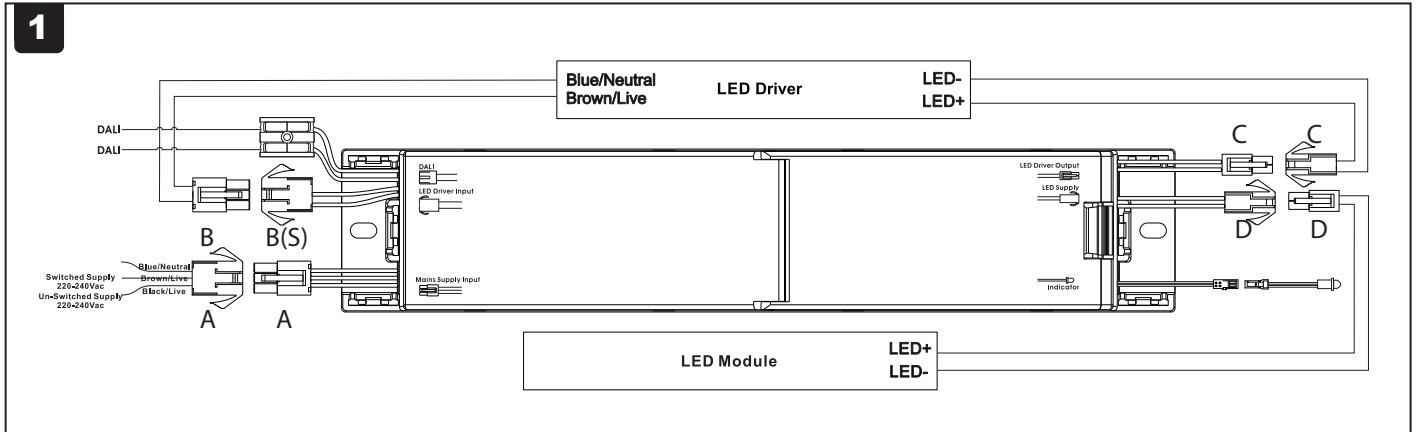

Ansell Electrical Products
Unit 6B, Stonecross Industrial
Park,
Yew Tree Way,
Warrington,
WA3 3JD

Ansell (Sales & Distribution)
Unit 2, M2 Business Park,
Duncrue Street,
Belfast,
BT3 9AQ

Ansell (Sales & Distribution) Republic of Ireland Limited
Unit G1, Block G,
Calmount Park, Ballymount
Dublin 12,
D12 TH56

www.ansell-lighting.com


Warrington Tel: +44 (0)1942 433333

Belfast Tel: +44 (0)2890 773750

International Tel: +44 (0)2890 773750

Spain Tel: 00 34 938 005642

Issue Number: [1]

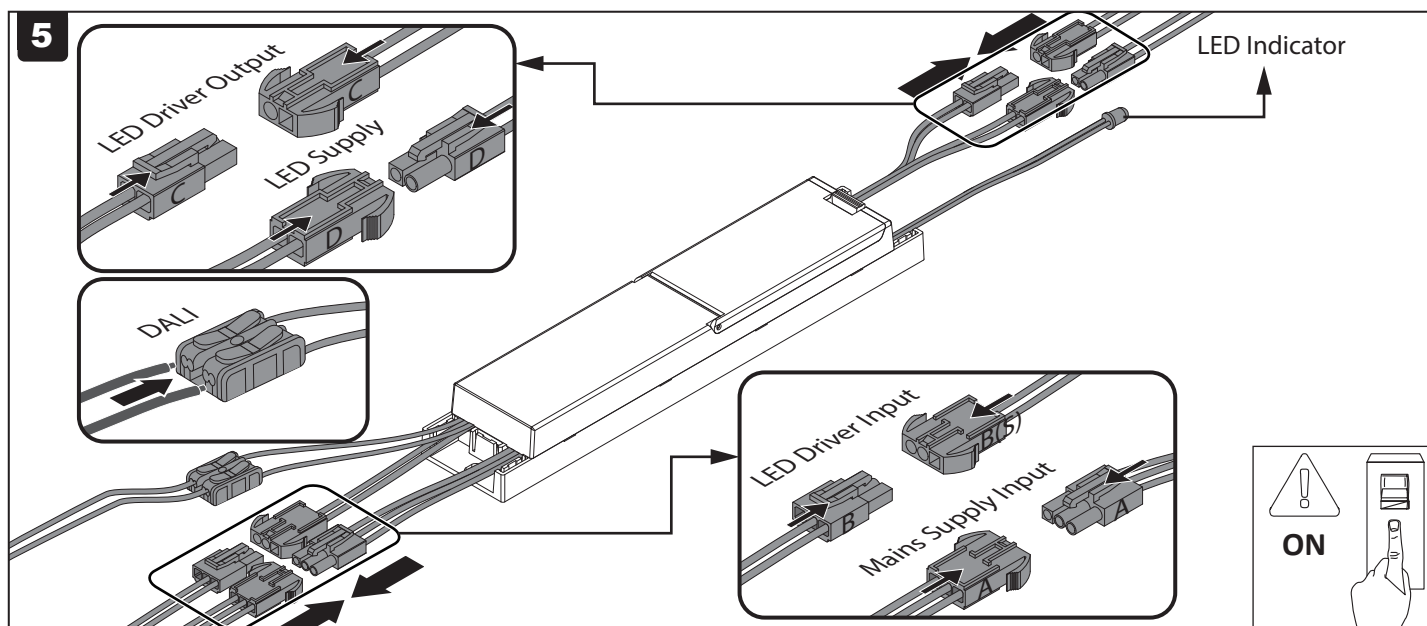

6 Emergency LED System Status

LED indication	Description	Status	Comment
	Green Permanently On	System Healthy	AC Mode
	Permanently OFF	Emergency Mode: Mains failure or mains disconnected	
	Green Slow Flash (1s on-1s off)	Battery Charge Inhibited	Battery outside operating temp
	Green Fast Flash (0.1s on-0.1s off)	Duration Test Running	
	Green Fast Flash (0.1s on-0.1s off)	Functional Test Running	
	Red Permanently On	Load Fault	Open circuit/ LED failure
	Red Slow Flash (1s on-1s off)	Battery Fault	Battery failed the duration test or function test / Battery is defect or deep discharged/ Incorrect battery voltage
	Red Fast Flash (0.1s on-0.1s off)	Battery Charging Fault	Incorrect charging current
	Green Fast Flash Twice (0.1s on-0.1s off) then off 1s	Inhibit Mode Activated	Switching into inhibit mode via controller
	OFF 2s then Green/Red Flash 6s (0.5s on-0.5s off)	Address identification	During address identification mode